


C-136DW/935  
208-VOLT, 3-PHASE

TEST FURNACE ONLY

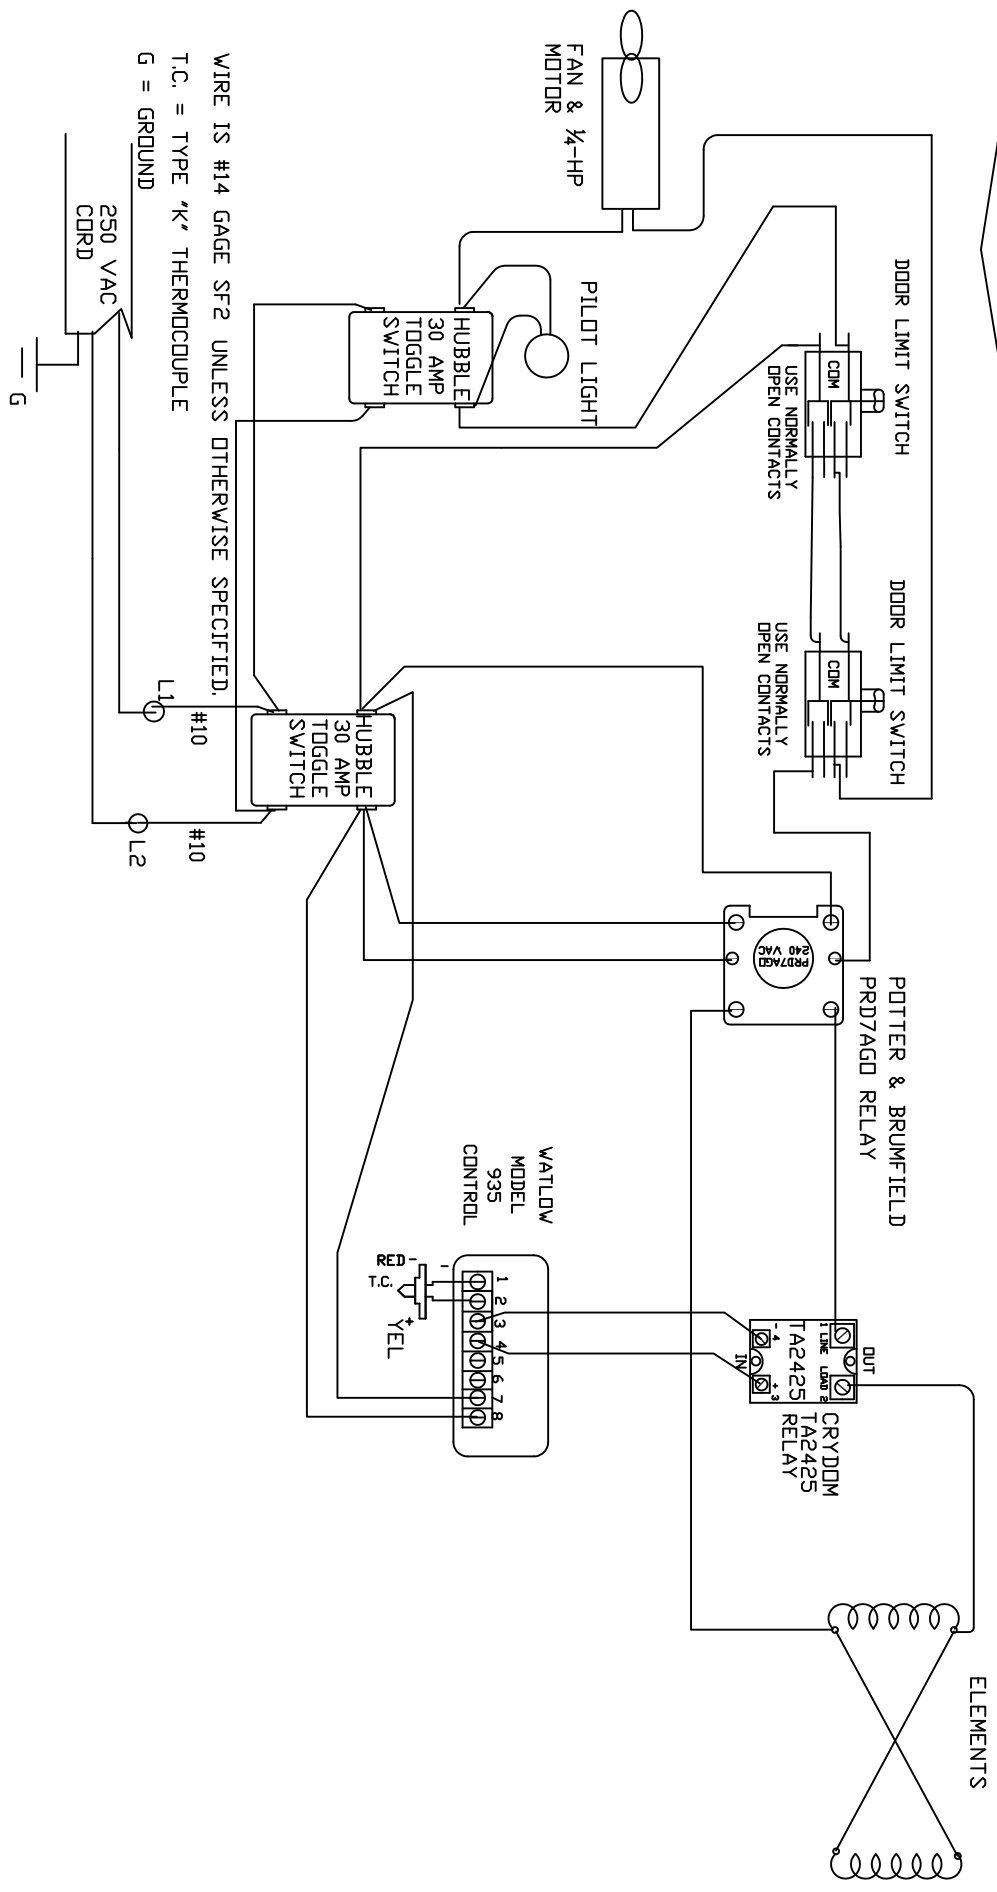

WIRE IS #14 GAGE SF2 UNLESS OTHERWISE SPECIFIED.  
T.C. = TYPE 'K' THERMOCOUPLE  
G = GROUND

250 VAC  
CORD  
G